



Volkswagen

Service Information

Diagnostic Device Hardware & Windows®

Number: VHW-16-05

Subject: VAS Diagnostic Laptops - Windows 7 System Recovery Instructions

Date: Feb. 18, 2016

Supersedes VHW-16-01 due to revised and additional information for VAS 6150D.

Table of Contents

Section	Page
1.0 Introduction - MUST READ!	2
1.1 General Information	2
1.2 Process Overview	2
2.0 Additional Documentation	3
3.0 Preparation Checklist	3
4.0 Recovery	4
5.0 Post-Recovery Setup	6
5.1 Windows 7 Startup & Initial Setup	6
5.2 Windows Update Settings	13
5.3 Network Setup & Internet Explorer Version	14
5.4 Reinstall & Configure Offboard Diagnostic Information System Service (ODIS Service) Diagnostic Software	18
5.5 Configure Diagnostic Interface	19
5.6 Supplementary Setup & Function	20
5.7 Windows 7 Update Management	21

Notes:

- Please **read these instructions carefully and in their entirety** before performing any procedures. **If you do not understand these instructions, arrange to have a qualified person perform these procedures.**
- Heed all prerequisite requirements and notes, and **follow all instruction steps in the Section order given.**
- **Discard all printed copies of this document after use.** Revised versions may be issued at any time. Always check ServiceNet for the latest version.



Service Information

1.0 – Introduction

1.1 – General Information

This document contains step-by-step instructions required to perform **Windows 7 operating system recovery** on **VAS 6150 A through D diagnostic laptop devices ONLY**.

Due to their function as diagnostic tools, **VAS diagnostic laptops** are equipped with a proprietary Windows 7 operating system. Unlike their commercially-available Panasonic equivalents, VAS laptops utilize a partitioned hard drive.

The Windows 7 recovery instructions provided here supersede any information contained in Panasonic manuals that may be included with the laptop.

Additional post-recovery setup steps are called out separately for VAS 6150A and VAS 6150D.

1.2 – Process Overview

Recovery

Windows 7 recovery files are located on the device's hard drive partition. The Windows recovery procedure is initiated to overwrite the existing (corrupt or malfunctioning) Windows 7 boot files with a copy from the hard drive partition.

All data on hard drive C:\ is erased and replaced. The Windows 7 recovery data resident on the hard drive partition is retained if recovery is required in future.

Post-Recovery Setup

The post-recovery setup steps described here are specific to the device's function as a diagnostic tester with installed ODIS Service diagnostic software.

Various Windows settings and configurations are necessary to ensure optimum function of the diagnostic software in the dealership workshop environment.

Diagnostic Software and Security Certificate Reinstallation

The Windows 7 recovery process deletes the previously-installed ODIS Service license and certificate files. As a result, **the license and security certificate files** that were originally obtained and saved as instructed in the **Installation Phase 1** instructions document **must be on hand for reinstallation**. A text document containing the device's **hardware key** should also be on hand.

If backup copies of the license and security certificate files were not saved: Replacements must be requested from their respective administrative websites (eShop & eCRMS) prior to reinstalling ODIS Service.

IMPORTANT!

If the Windows - Panasonic CDs originally included with the device when new were retained, please LOCATE and DISCARD THESE DISCS NOW! Inadvertent use of the Panasonic CDs for recovery will completely erase the device-specific data and partitioned image, and install a standard, non-partitioned Windows XP or Windows 7 operating system.



Volkswagen

Service Information

2.0 – Additional Documentation

These instructions include references to the following **Service Information (SI)** documents that contain additional instruction steps needed before returning the laptop to service. Locate and print as necessary.

SI Document Category	Document Titles
ODIS Service	Installation Phase 1 – Preparation, License & Security Certificate Process Instructions
	Installation Phase 2 - Software Installation & Configuration Instructions
Diagnostic Device Hardware & Windows	VAS Diagnostic Device Computer Name Builder
	VAS 5054A Diagnostic Interface - Bluetooth & EDIC Configuration
	VAS 5054A Diagnostic Interface - USB Configuration
Additional Documentation steps completed. Proceed to Section 3.0 – below.	

3.0 – Preparation Checklist

Complete the **Preparation Checklist** below. Additional checkboxes are provided throughout this document to note the fulfillment of prerequisites, completion of sections etc..

✓	Preparation Checklist
	Print the additional documentation from ServiceNet as specified in Section 2.0 .
	Note the device type and model number.
	Connect the A/C power adapter directly to the laptop.
	If the device is capable of booting to Windows and starting ODIS Service: Finalize all saved diagnostic sessions and transmit logs where applicable.
	Disconnect the Ethernet (network) cable where applicable.
	Switch the Wireless Operation Switch to the OFF position as illustrated -arrows- :
	 VAS 6150A Front panel behind handle  VAS 6150B/C Middle right side behind WIRELESS door  VAS 6150D
	All Preparation steps completed. Proceed to Section 4.0 – Page 4.



Service Information

4.0 – Recovery

Prerequisites:

- ☐ All devices **removed** from their base station (port replicator) where applicable.
- ☐ Confirm: Ethernet cable **DISCONNECTED** & wireless operation switch in the **OFF POSITION!**

ATTENTION!

The A/C power adapter must be connected directly to the device during recovery. **DO NOT** recover on battery power alone!

1. Turn on the diagnostic device.
2. When the **Panasonic** or **VWAG Workshop Equipment** logo is displayed, quickly press the **F2** key on the keyboard to enter the setup.





A password prompt appears.

3. Note the **device-specific** password from the table below:

Model	Password
VAS 6150A	vas6150
VAS 6150B	vas6150b
VAS 6150C	vas6150c
VAS 6150D	vas6150

4. Enter the password **exactly as noted above** (lower case, no spaces):
5. Press the keyboard (or onscreen keyboard) **Enter** key:

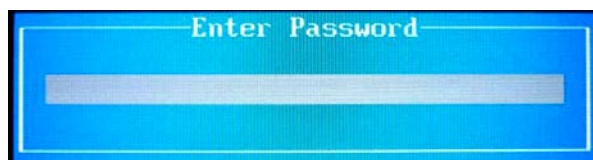

(cont.)





Service Information

6. Use the **right and left arrow keys** to select the **Exit** tab:


7. Using the **up and down arrow keys**, select **either**:

Repair Your Computer **OR** **Recovery Partition** ...as applicable, and then press the **Enter** key to continue:

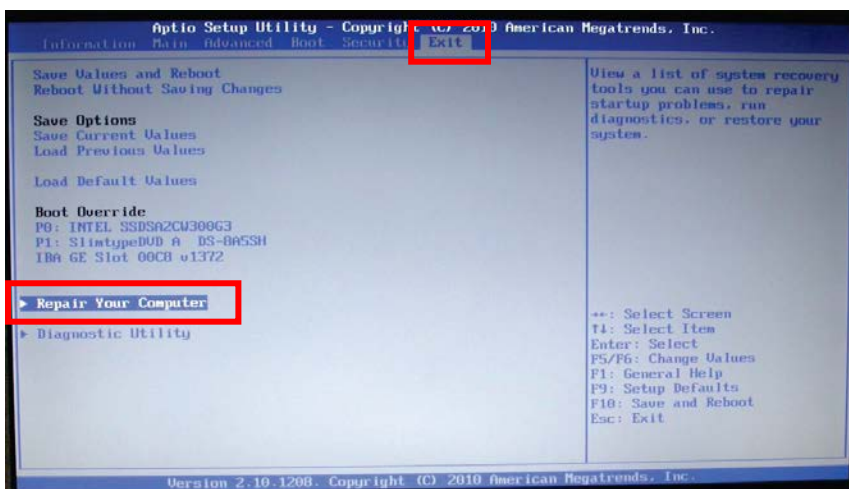


After the **Enter** key is pressed, the system recovery starts. After approximately 2 minutes, the message **“System will be recovered”** is displayed.

8. **Press the 2 key**, then press the **Enter** key to continue:

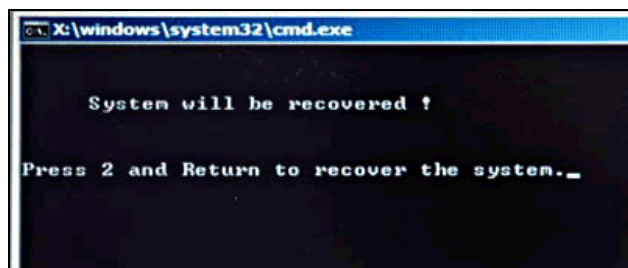

.....



- Allow 30 – 90 minutes for device recovery (device-dependent).
- The progress window may appear to stall at 99% - 100%. Please be patient!
- When complete, the system will automatically reboot and display a series of automatic setup, registry and service screens followed by the initial Windows setup screen.

☐ Recovery steps completed. Proceed to [Section 5.0 - Page 6.](#)



Service Information


5.0 – Post-Recovery Setup

5.1 – Windows 7 Startup & Initial Setup


Note:

*The initial language selection made in Step 1 below cannot be changed after the device is placed in service. **Avoid having to repeat the recovery process by selecting the language carefully!***

1. If the following Windows setup screen appears, **carefully scroll down** and select **My language is English** and select **Next: ...otherwise, skip to Step 2.**

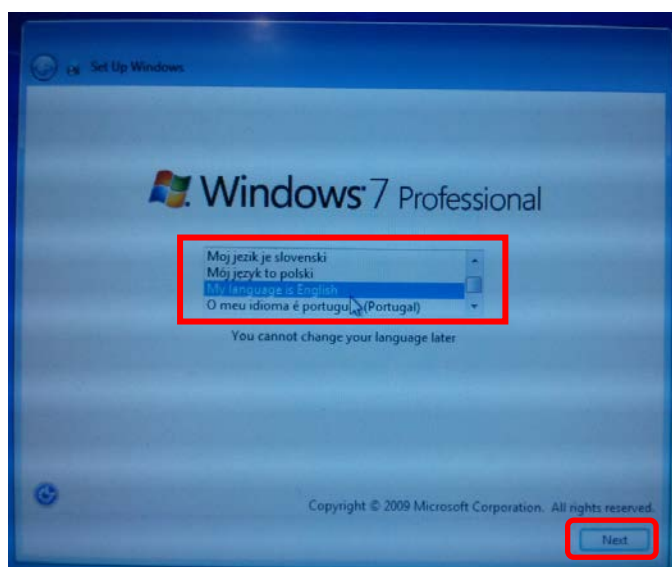

2. **Confirm** the regional settings, time/currency and keyboard layout as illustrated, and then select **Next:**

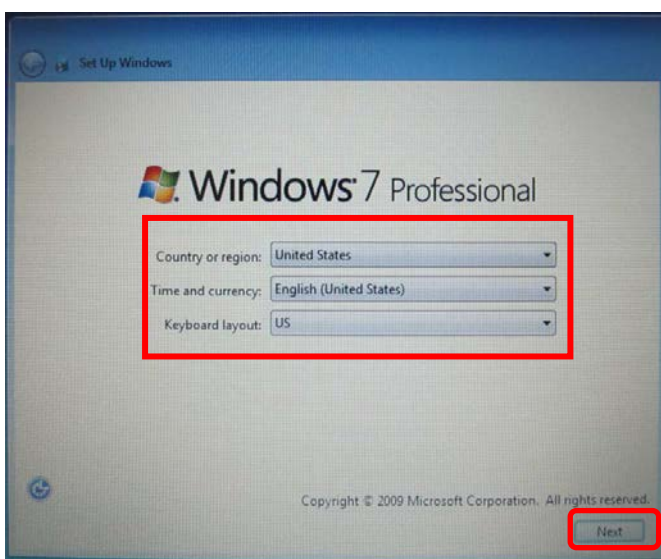


(cont.)




Volkswagen

Service Information

3. If the **license terms and conditions are displayed**, accept by checking the appropriate boxes and click **Next**: ...otherwise skip to Step 4.

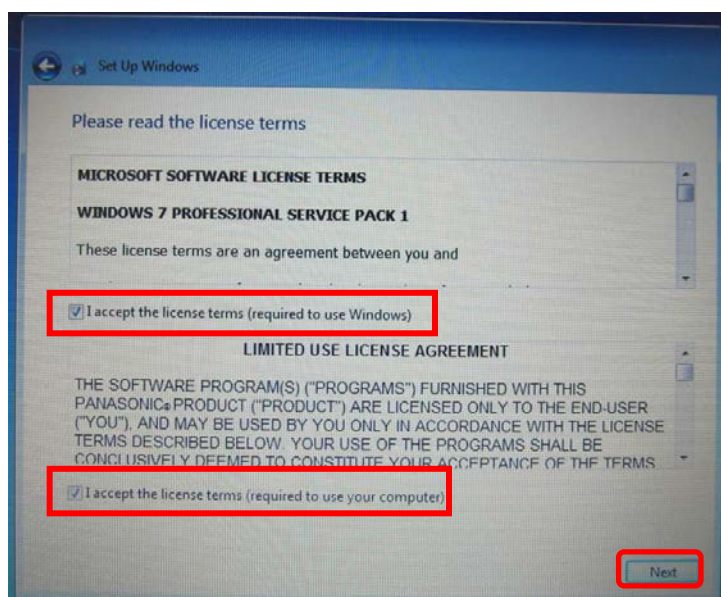

4. Set the **Time Zone, Daylight Saving Time, Date** and **Time** as applicable to your location. Click **Next**:

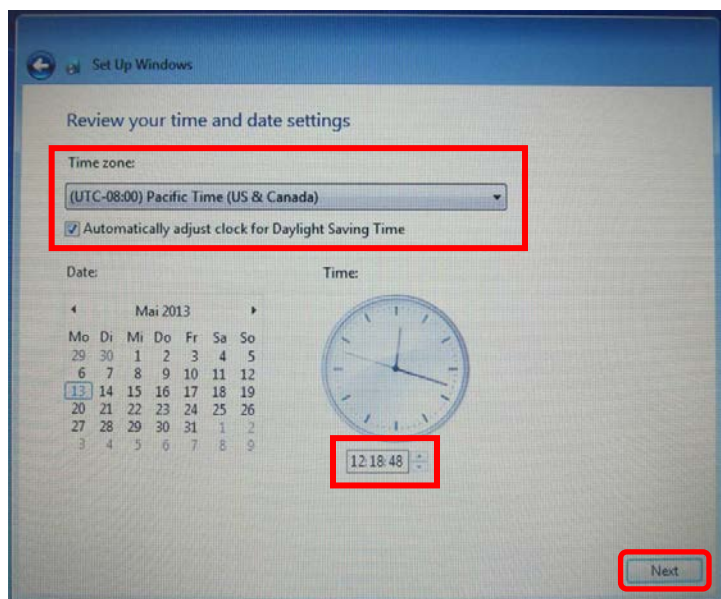

- Various settings are saved and the device automatically reboots to the Windows desktop.
- For convenience, the device can now be returned to its base station **if desired** (not mandatory).
- In all cases **the A/C power adapter must remain connected** for the following procedures. The USB mouse and keyboard should also remain connected where applicable.



Service Information

5.1.1 – VAS 6150A/B/C - Delete Non-Applicable Information


The Windows 7 desktop may include documents that are not applicable to the -US/CDN- market. **If present as described below, please delete these documents** as follows:

1. From the Windows desktop: **Locate** two document **shortcut icons** entitled:


HowTo Guide_ODIS Service Set-Up_EN and **HowTo Guide_ODIS Service Set-Up_DE**:



2. **Right-click** a shortcut icon, and then select **Delete** from the dropdown.
3. When prompted to confirm file delete, click **Yes**. Repeat for the remaining icon.
4. From the Windows desktop: **Open** the **Manuals** folder:




5. **Right-click** the **OffboardDiagService** folder, and then select **Delete** from the dropdown, **confirm** the deletion when prompted and then **Empty** the **Recycle Bin**.

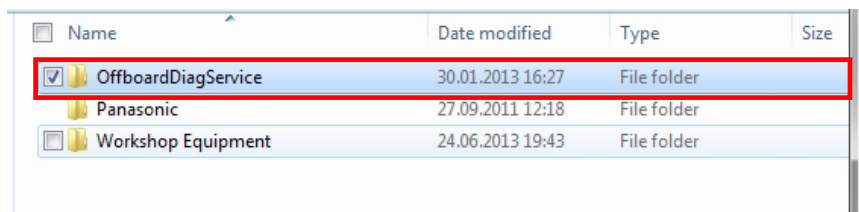

5.1.2 – VAS 6150D – Delete Non-Applicable Information

The Windows 7 desktop includes a document folder with information not applicable to the -US/CDN- market. **Please delete the folder** as follows:

6. From the Windows desktop, right-click the **manuals** folder:




7. Select **Delete** from the dropdown menu, **confirm** the deletion when prompted and then **Empty** the **Recycle Bin**.




Service Information

5.1.3 - Confirm Keyboard Language


1. Go to: **Windows (Start)**  > **Control Panel > Region and Language:**



2. **Select the Keyboards and Languages tab. Click Change Keyboards...:**

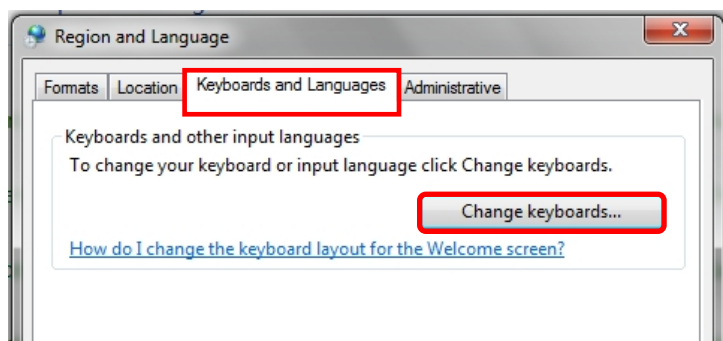

3. **Confirm** that the **Default input language** is set to **English (United States) - US** as illustrated below. If not, select it from the dropdown.
4. **If the German (Germany) input language service appears, select it and click Remove.**
5. If any changes were necessary, save them by clicking **Apply**, and then **OK**:

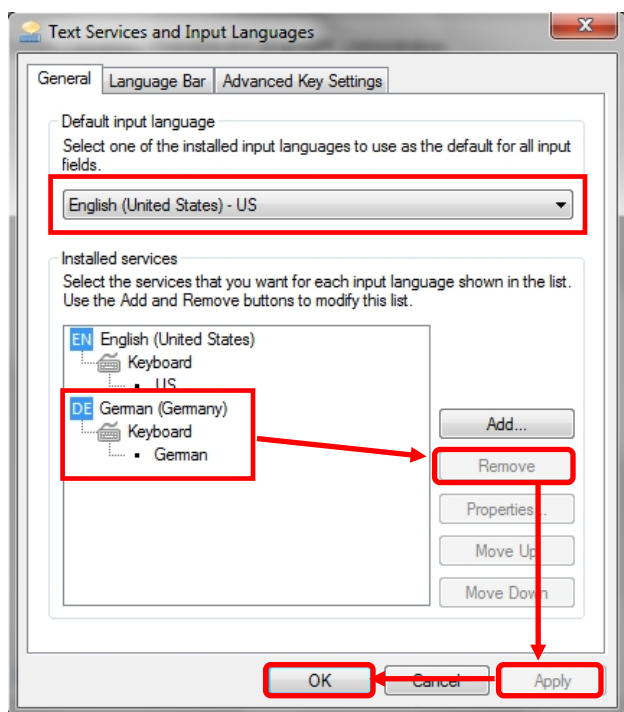

6. Close the languages window and return to the **Control Panel** menu.



Service Information


5.1.4 – Device Power Management

To ensure uninterrupted data transfer when performing lengthy Software Version Management (SVM) procedures, configure the device to remain on as follows:


1. Go to: **Control Panel > Power Options:**



2. From the Control Panel Home menu, select **Choose when to turn off the display:**

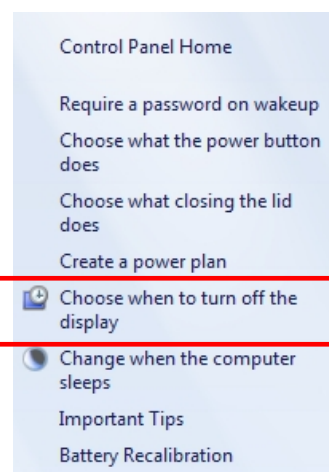

3. Select **Never** from the dropdowns as illustrated:

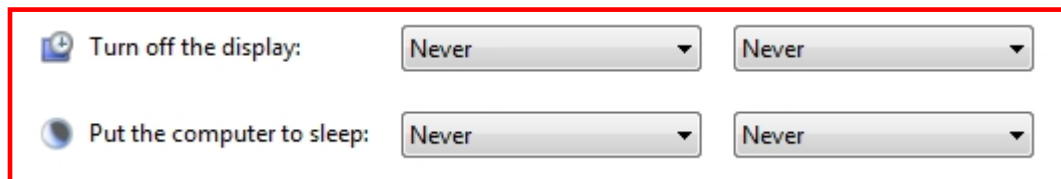

4. Click **Save changes** (at bottom frame):



5. **Close** the power options window and return to the **Control Panel** menu.
6. **Check and proceed** to the model-specific sections as applicable:

- ☐ **VAS 6150A:** Proceed to [Section 5.1.5 – Page 11.](#)
- ☐ **VAS 6150B/C/D:** Proceed to [Section 5.1.6 – Page 13.](#)




Service Information


5.1.5 – **VAS 6150A** - Increase Paging File Size

For optimum performance, increase the paging file size **on VAS 6150A laptops** as follows:


1. Go to: **Control Panel > System**:



2. From the Control Panel Home menu, click **Advanced system settings**:

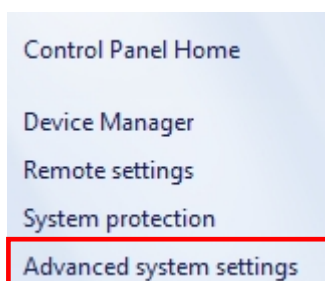


3. Select the **Advanced** tab. In the **Performance** category, click **Settings**:

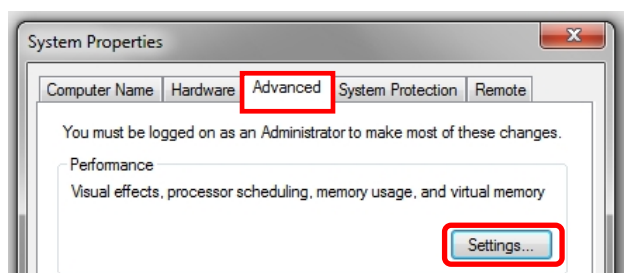

(cont.)

4. Select the **Advanced** tab. In the **Virtual memory** category, click **Change**:

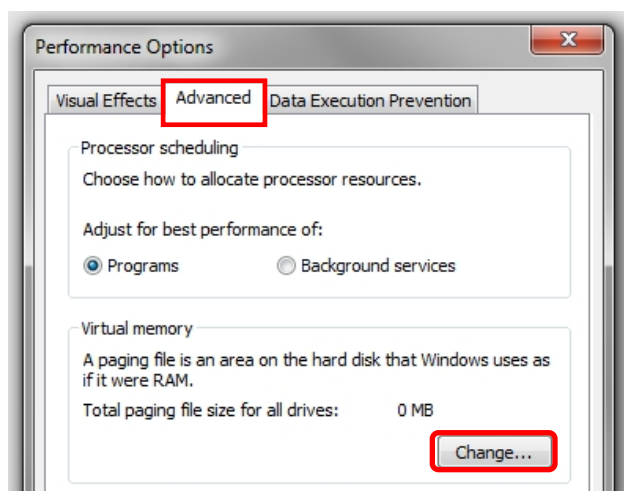


(cont.)




Service Information

5. Ensure **Automatically manage paging file size for all drives** is **deselected** and **Drive [Volume Label] C:** is highlighted:
6. Select **Custom size:**, and then **enter 6000** in both the **Initial** and **Maximum** size entry fields as illustrated below: When complete, click **Set**:

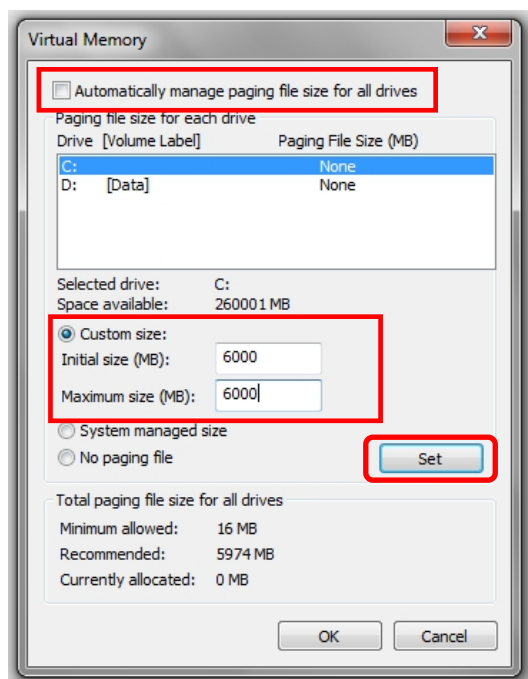

7. Ensure that the **Paging File Size (MB)** indicated for **C:** is displayed as **6000 - 6000**: Click **OK**:

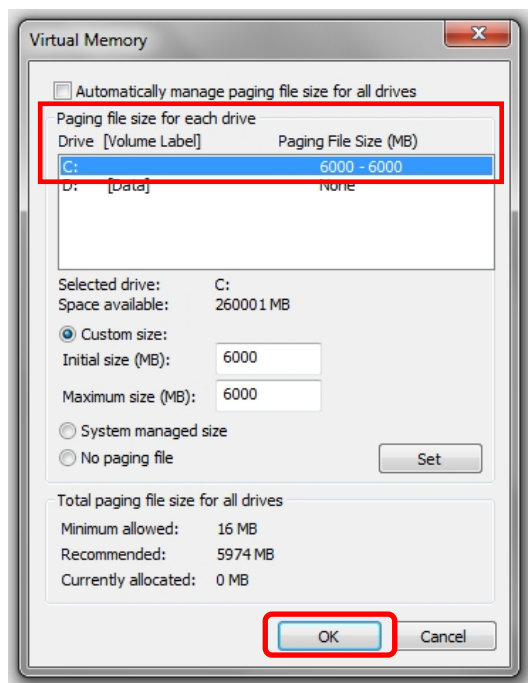

Note:

The recommended page file size of 6000 MB allows for 2GB of additional RAM that may be added.




Service Information

5.1.6 – Restart Windows

A restart is required to complete automatic Windows configurations on certain devices. Proceed as follows, and note the **Windows 7 Shut down** and **Restart** routines for future reference:

1. Close all windows and **Restart** the device. Go to: **Windows (Start)**  >  > **Restart:**

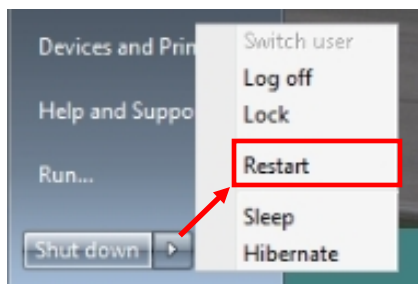

Windows 7 Startup & Initial Setup steps complete – Proceed to Section 5.2 below.

5.2 – Windows Update Settings

The default setting for Windows updates is to automatically download files when a network connection is present, and then prompt the user to install them.

As the automatic background loading of (often large) Windows files can place significant loads on the device memory, ODIS Service online update functions that may run simultaneously are negatively affected.


Change the default setting to (manually) check for updates and prompt the user to choose the updates as specified below.

Perform the following configuration **BEFORE** setting up the network connection:

1. Go to: **Windows (Start)**  > **Control Panel > Windows Update:**



2. From the Control Panel Home menu, select **Change settings:**

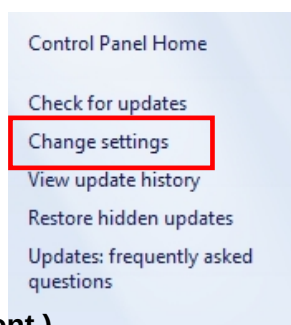


(cont.)



Service Information

3. Select the “**Check... & ...choose**” update method from the **Important updates** selection dropdown:

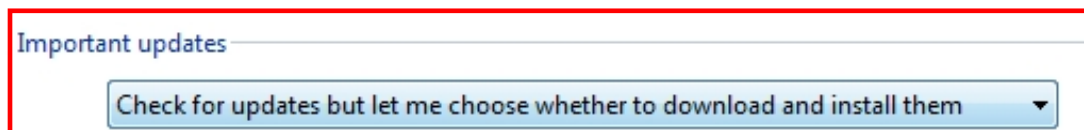

4. Click **OK** (at bottom frame):



5. **Close** the **Control Panel** window.

☐ **Windows Update Settings steps completed – Proceed to Section 5.3 below.**

Note:

*Before proceeding with **Sections 5.3 through 5.5**, have the additional documentation specified in Section 2.0 – Page 3 on hand.*

5.3 – Network Setup & Internet Explorer Version

5.3.1 – Set Computer Name

If more than one VAS diagnostic device is connected to the dealership network, each device must be assigned a different computer name.

Assign the computer name before proceeding. For detailed instructions refer to **Service Information – Diagnostic Device Hardware & Windows** document title: **VAS Diagnostic Device Computer Name Builder**

5.3.2 – Enable Network Connections

For dealership networks using **DHCP** for Internet access, no network connection configuration is necessary (the device default setting is DHCP).

For networks using **Static IP** configurations for Internet access, the IP configurations must be renewed by manual entry of the dealership-specific IPs. Ask your dealership systems administrator or IT professional for details and assistance.

VAS 6150A/B/C: If the device is to be used over a Wireless Local Access Network (WLAN) connection, switch the wireless switch to the ON position and perform the dealership-specific wireless configuration at this time. Ask your dealership systems administrator or IT professional for details and assistance. When completed, skip to [Section 5.3.4 – Page 17.](#)

VAS 6150D: If the device is to be used over a WLAN connection, proceed to [Section 5.3.3 – Page 15.](#)



Volkswagen

Service Information

5.3.3 – VAS 6150D – Enable WLAN


Prerequisite:

☐ DHCP, or static IPs enabled.


1. Open the **WIRELESS / Headphones / SD slot** access cover (right side – middle) and switch the wireless operation switch to the **ON** position:



2. From the Windows taskbar (window footer), click the **Show hidden icons** arrow:

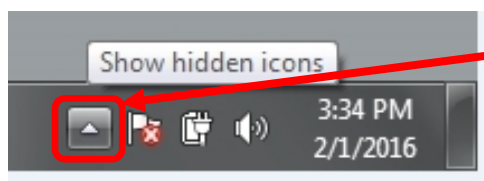

3. Click the **Wireless Connection Status** icon to reveal its status / selection submenu:

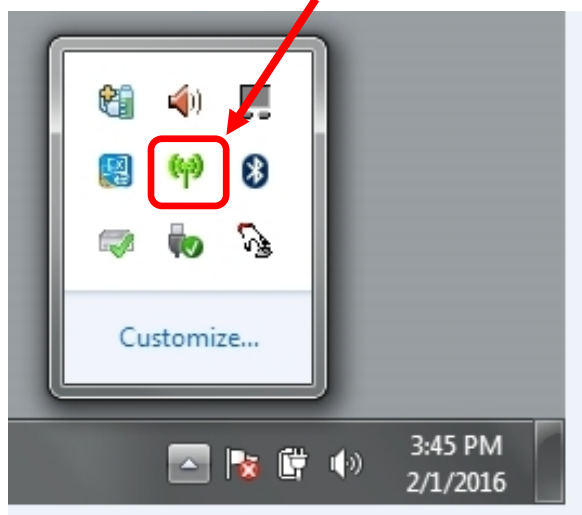


(cont.)




Volkswagen

Service Information


4. Enable the **Wireless LAN ON** and **802.11a Enabled** selections by **checking them** as illustrated: (The status / selection submenu must be reopened for each selection check.)

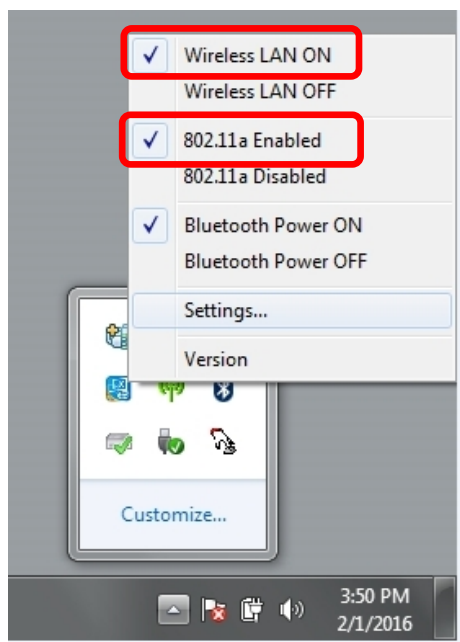

5. Click the **Show hidden icons** arrow again, and then click **Customize**:

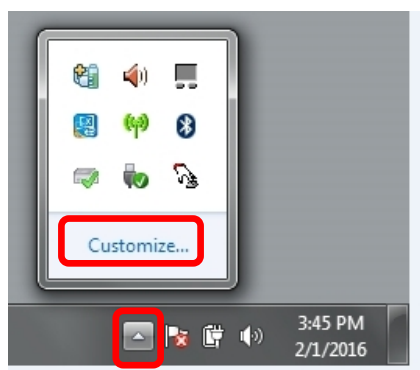

6. Select **Turn system icons on or off**:

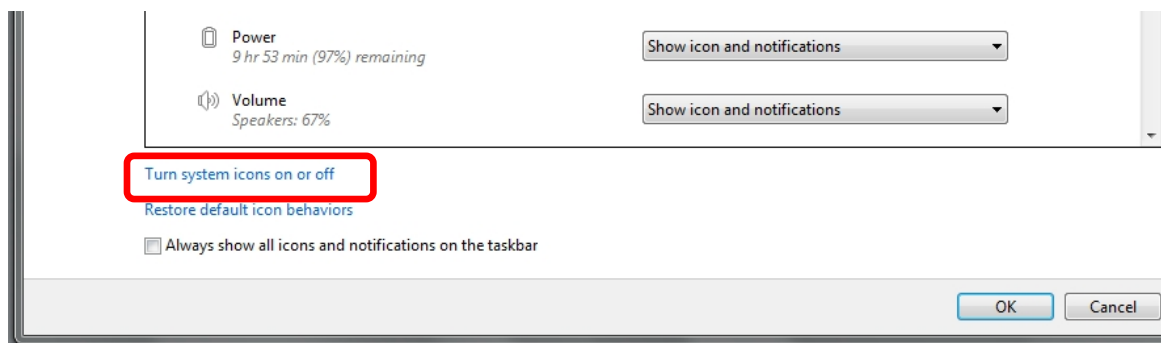


(cont.)



Service Information

7. Select **On** from the **Network** system dropdown as illustrated, and then select **OK**:

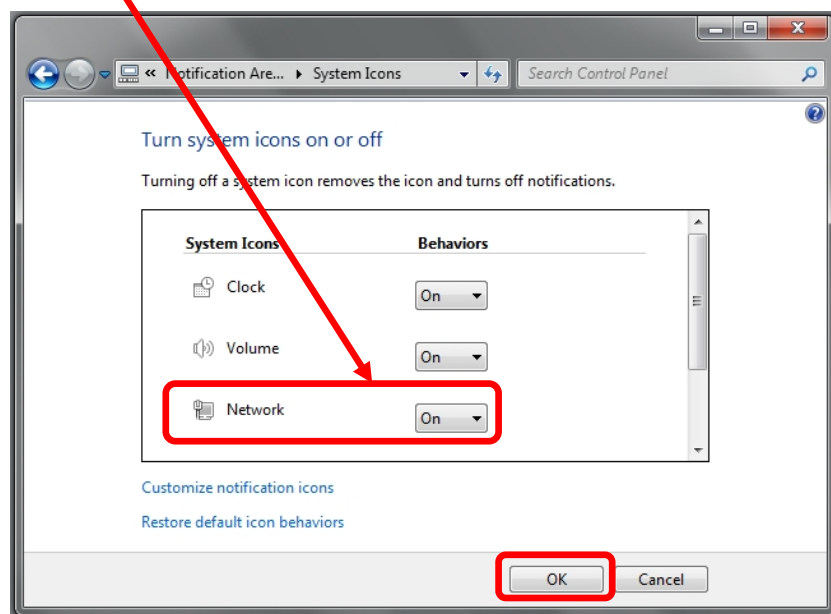


8. Close the remaining windows and proceed with any dealership-specific wireless configuration at this time. Ask your dealership systems administrator or IT professional for details and assistance.

Network Functions Tip for Pros:

For quicker access during use, consider selecting the **Wireless Connection Status** and **Bluetooth** icons (and any others desired) from the **Hidden icons** window, and use the Windows “drag and drop” function to move them to the taskbar.

Example:

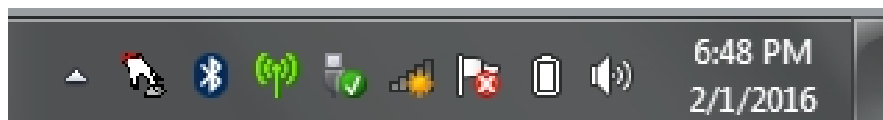

5.3.4 – Download & Install Internet Explorer 11

The Microsoft Internet Explorer version installed in the recovery partition is IE9.

For up-to-date browser support and optimum performance of web-based functions hosted by Volkswagen AG Group Services and VWGoA, we recommend **updating the browser to IE11 before continuing** with setup.

Prerequisite:

- ☐ DHCP, or static IPs enabled.

(cont.)



Volkswagen

Service Information

Note:

The information below was current at the time of publication. IE11 availability via the Microsoft website category titles mentioned below are subject to change.

1. Launch **Internet Explorer** and go to the **Microsoft.com** website.
2. From the Microsoft main page header, navigate through **Products > Software & services > Internet Explorer**
3. Select **Get it now** or the equivalent marker for IE11 software download.
4. Follow the download and installation prompts.
5. Restart the device when prompted.
6. Allow the Windows update configurations to **run undisturbed** on shutdown and restart.

☐ **Network Setup steps completed – Proceed to Section 5.4 below.**

5.4 – Reinstall & Configure Offboard Diagnostic Information System Service (ODIS Service) Diagnostic Software

Prerequisite:

☐ *Backup copy of the original ODIS Service license and security certificate files available.*

1. Import the **ODIS Service Security Certificate** to Windows. For detailed instructions, refer to **ODIS Service – Service Information** document title:

Installation Phase 1 - Preparation, License & Security Certificate Process Instructions

(Go directly to **Section 4.3 – Page 24** in the **Phase 1 document**.)

2. Install and configure ODIS Service. For detailed instructions, refer to **ODIS Service – Service Information** document title:

Installation Phase 2 – Software Installation & Configuration Instructions

☐ **ODIS Service Installation Phase 2 steps completed.**



Service Information

5.5 – Configure Diagnostic Interface

VAS 6150A/B/C with VAS 5054A:

1. Perform the Windows Bluetooth and EDIC configuration for wireless operation. For detailed instructions refer to **Service Information - Diagnostic Device Hardware & Windows** document title:

VAS 5054A Diagnostic Interface – Bluetooth & EDIC Configuration

2. Perform the UBS configuration for cabled operation. For detailed instructions refer to **Service Information – Diagnostic Device Hardware & Windows** document title:

VAS 5054A Diagnostic Interface – USB Configuration

VAS 6150D with VAS 6154:

Configure interface for USB operation. For detailed instructions refer to **Service Information - Diagnostic Device Hardware & Windows** document title:

VAS 6150D Diagnostic Laptop – Unpacking and Setup Instructions (Section 12.0)

	Diagnostic Interface configuration steps completed.
--	---

	Windows 7 and ODIS Service reinstallation completed. Supplementary instructions: Refer to Section 5.6 – Page 20 and Section 5.7 – Page 21 .
--	--



Service Information

5.6 – Supplementary Setup & Function

Depending on the recovered diagnostic device's previous preparation level and/or dealership requirements, the following supplementary setup procedures **may or may not** be required. Review and confirm as applicable.

5.6.1 – VAS 6356 Test Instruments Box - Configuration

If a VAS 6356 Test Instruments Box was previously configured for use with the recovered device, it must be connected and the initial configuration repeated.

For detailed instructions refer to **Service Information – Diagnostic Device Hardware & Windows** document title: **VAS 6356 Test Instruments Box – Software Configuration – ODIS Service Only**

☐	Completed	☐	Not applicable
--------------------------	-----------	--------------------------	----------------

5.6.2 – Printer Driver Reinstallation

If a USB (cabled) or wireless (WLAN) printer was previously configured for use with the updated device, the necessary driver installation and/or configuration must be repeated.

Obtain the printer driver CD where applicable and refer to the installation documentation supplied with the printer. Ask your dealership systems administrator or IT professional for assistance if necessary.

☐	Completed	☐	Not applicable
--------------------------	-----------	--------------------------	----------------

5.6.3 – Reinstall Antivirus Software

Reinstall the antivirus software as may be required by the dealership IT policy. Ask your dealership systems administrator or IT professional for assistance if necessary.

☐	Completed	☐	Not applicable
--------------------------	-----------	--------------------------	----------------



Service Information

5.7 – Windows 7 Update Management

5.7.1 – General Information

All VAS diagnostic devices must be kept up-to-date with the latest Windows security and vulnerability updates. However, dealership service or IT personnel tasked with maintaining both ODIS Service and Windows updates **must be aware of the following, and act accordingly:**

The initial package of important Windows updates available for a Windows 7 reinstallation may take considerable time to install and download (typically 120 minutes or more, device, content and bandwidth dependent). As a result, we recommend that the initial selection, download and installation of Windows updates **be managed so that the update process takes place outside of workshop service hours.**

Instructions on how to initiate Windows updates follow in the **Managed Windows Update** section below.

5.7.2 – Managed Windows Update Procedure

Prerequisites:


- ☐ Diagnostic device removed from service, after hours etc.
- ☐ Diagnostic device with active network connection.

Go to: **Windows (Start)**  **> Control Panel > Windows Update:**




1. Click **Check for updates:**

Windows Update

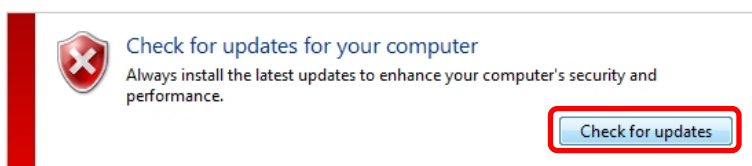

2. The first time after a Windows 7 reinstallation, an update prompt for **Windows Update** may or may not appear. If so, click **Install now:**

Windows Update

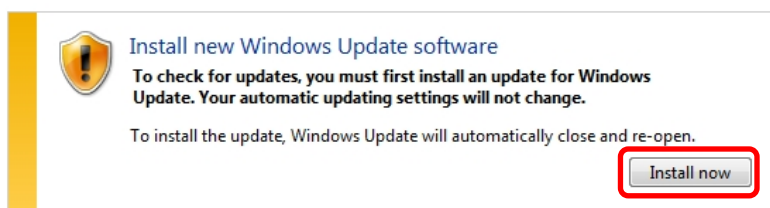




Volkswagen

Service Information


3. **Wait** while an update for Windows Update is installed:

Windows Update

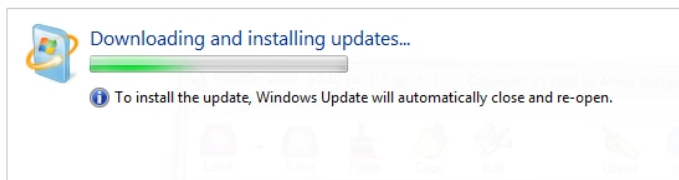


5. After the update closes and re-opens, **wait** while the system checks for updates. (This process make take 30 minutes or more. Please be patient.):

Windows Update

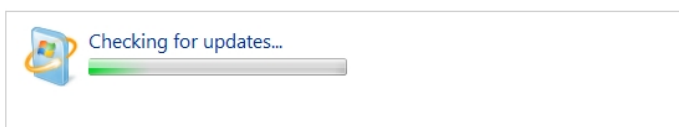

6. When the results are displayed, select **Install Updates**:

Windows Update

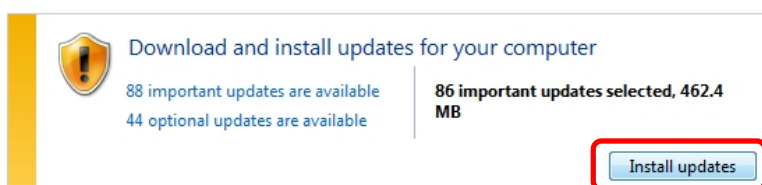


Notes:

- The number of updates illustrated **is for reference only!** The number of available updates will always vary depending on type of device and date when available updates are checked.
- It is recommended to **not** download and install “optional” updates. For details refer to **Service Information – Diagnostic Device Hardware & Windows** document title: **Optional Windows Updates**


7. Accept any **Microsoft License Terms** if prompted, and then click **Finish**.

8. **Wait** while the updates are downloaded and installed (no user intervention is necessary):

Windows Update

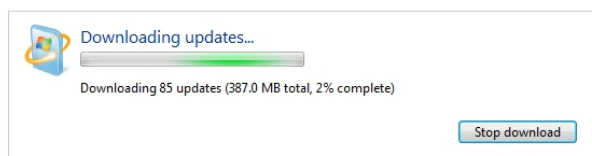

Windows Update

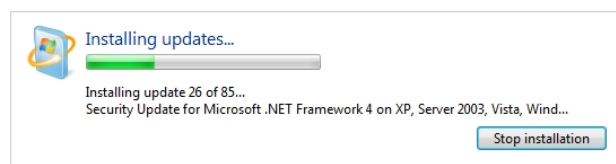




Service Information

9. Click **Restart now**:

Windows Update

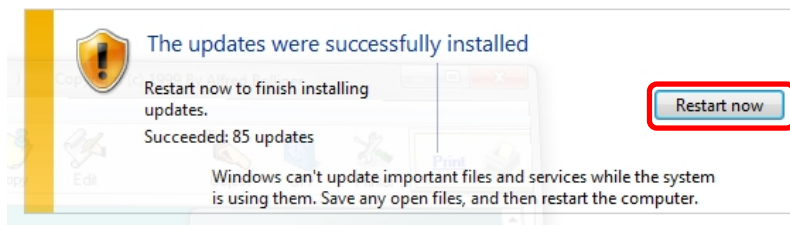

- Additional Windows update configurations are performed during the shut-down and restart routine.
- On completion, the device boots to the Windows desktop, and an information prompt on the installed updates appears.