


HVAC Flange, Installation
VN, VHD, VAH

FSB 873-020, HVAC Flange, Installation

(May 2016)

The new flange bracket used to secure the AC lines to the HVAC units (front & bunk) may be installed incorrectly starting in production week1614. Follow the reference image in this Field Service Bulletin (FSB) to ensure proper installation of the HVAC flange bracket.

Note: The HVAC flange bracket should be installed with the machined Surface (1) facing away from the main and bunk climate unit as shown in the reference image.

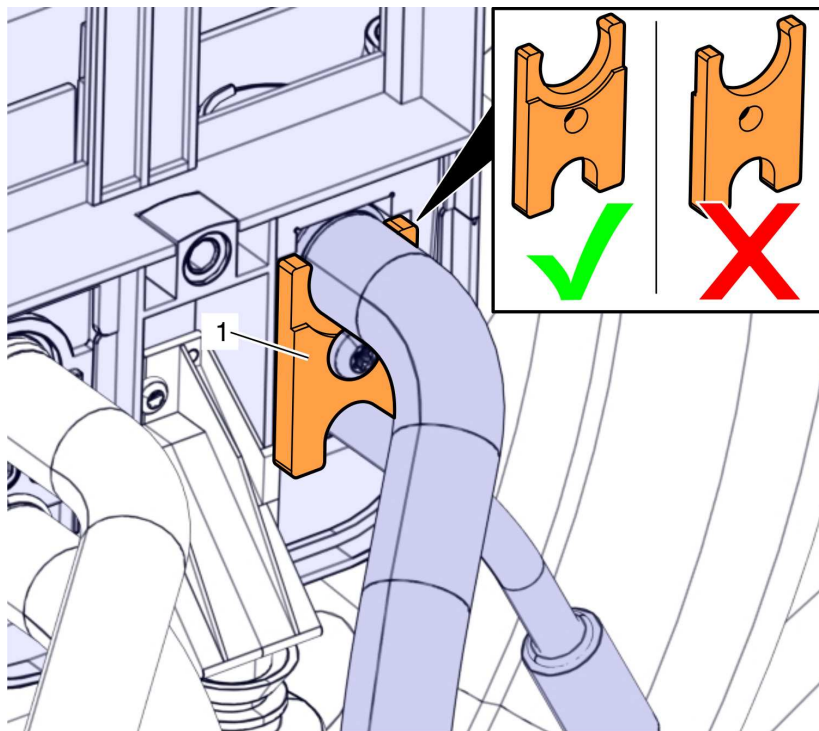

W8112139