Electrical Equipment Panel Label

M-390-001

(April 2008)

Valid for

All MRU

Case description

On MRU models, the electrical equipment panel label (located on the underside of the electrical center access panel), may present some confusion as to how it illustrates the location of the relays and fuses on the actual panel. The illustration below shows the label as it appears on the access panel, and the electrical equipment panel as it is seen when seated in the rider's seat. To avoid confusion, use the 30 amp HVAC circuit breaker as a reference point when performing any type of service involving the electrical equipment panel.

Electrical Equipment Panel Label and Actual Panel

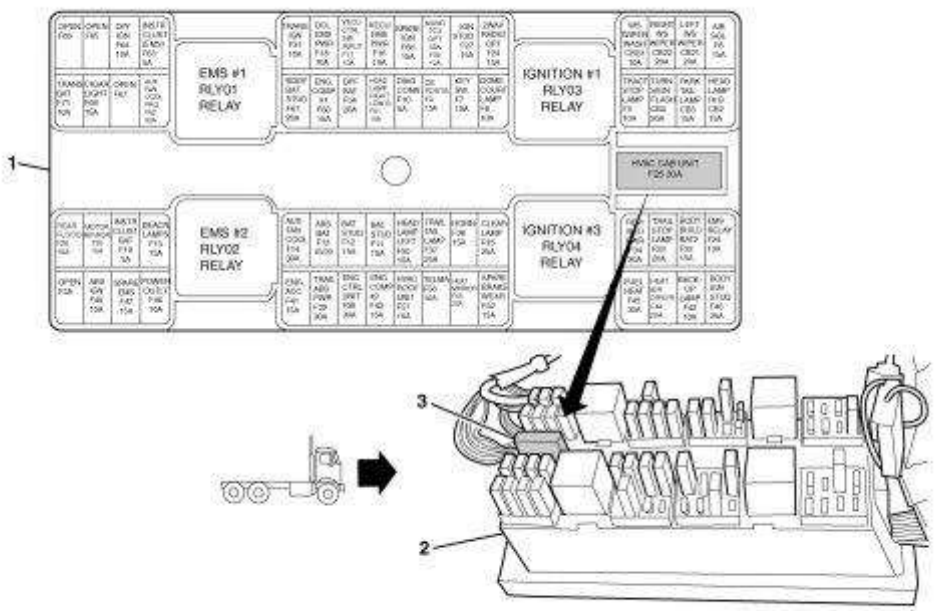

1. Label	3.HVAC Circuit Breaker (30-Amp)
2. Panel	

Note: Not applicable to Mack Trucks Australia.

Caution

Always be aware of the correct fuse/circuit breaker locations. When reprogramming an electronic control unit, failure to remove the correct fuses can fatally damage the ECU.

Issued by

Technical Service